

### NOTE:

REFER TO WRTTTEN SPECIFICATION SECTION OF THE CURRENTLY APPROVED PERFORMANCE-BASED PLANTING IRRIGATION SPECIFICATION (32 84 00) FOR ADDITIONAL REQUIREMENTS

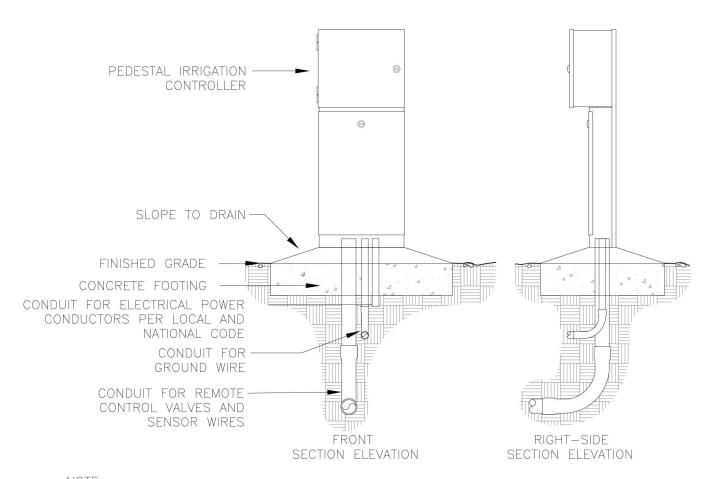

#### NOIE:

- 1. INSTALLATION TO BE COMPLETED IN ACCORDANCE WITH MANUFACTURER'S SPECIFICATIONS AND BEST PRACTICES.
- 2. HIGH AND LOW VOLTAGE ELECTRICAL WORK IS TO BE PERFORMED BY A LICENSED ELECTRICIAN
- 3. GROUND CONTROLLER IN ACCORDANCE WITH MANUFACTURER RECOMMENDATION.

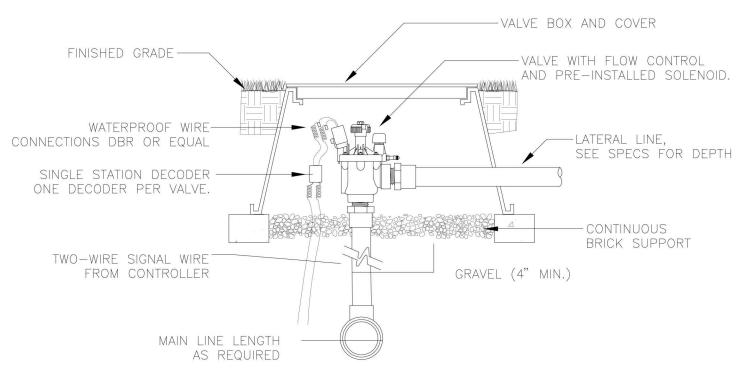

#### NOTE:

- 1. INSTALLATION TO BE COMPLETED IN ACCORDANCE WITH MANUFACTURER'S SPECIFICATIONS AND BEST PRACTICES.
- 2. SET VALVE BOXES AT FINAL GRADE OR HIGHER AS LANDSCAPE INDICATES SO THAT THEY ARE VISIBLE BUT NOT A HAZARD.
- 3. VALVE BOX BOTTOMS ARE TO BE SUPPORTED ON BRICKS OR SUITABLE HARD MATERIAL TO PREVENT BOXES FROM BEING PUSHED BELOW GRADE.
- 4. INSTALL CONTROLS VALVE IN PROPER IRRIGATION BOXES, AS PER INDUSTRY STANDARDS FOR EASE OF SERVICE AND MANUAL OPERATION. SEE IRRIGATION SPECIFICATION.
- 5. UTILIZE EXTENSION KITS AS REQUIRED.
- 6. ADD FOUR-INCHES OF 3/4-INCH CRUSHED GRAVEL SUMP PER BOX.
- 7. ALLOW FOR NOT LESS THAN 24" WIRE SLACK COILED NEATLY IN CONTROL BOX.



# 2-WIRE PEDESTAL CONTROLLER SAMPLE

 $1" = 1' - \emptyset'$ 



## VALVE W/ SOLENOID AND DECODER SAMPLE

 $1 \ 1/2$ " =  $1'-\emptyset$ "

